


RECOMMENDED REGULATOR PIPING SPENCE T14 PILOT

T. Connect temperature sensing line from T-T
Steam Main



Direct contact steam heating will induce some vibration. Housekeeping pads and grouted bases will dampen vibration.
Installation above ground floor will increase vibration and may require additional structural considerations.

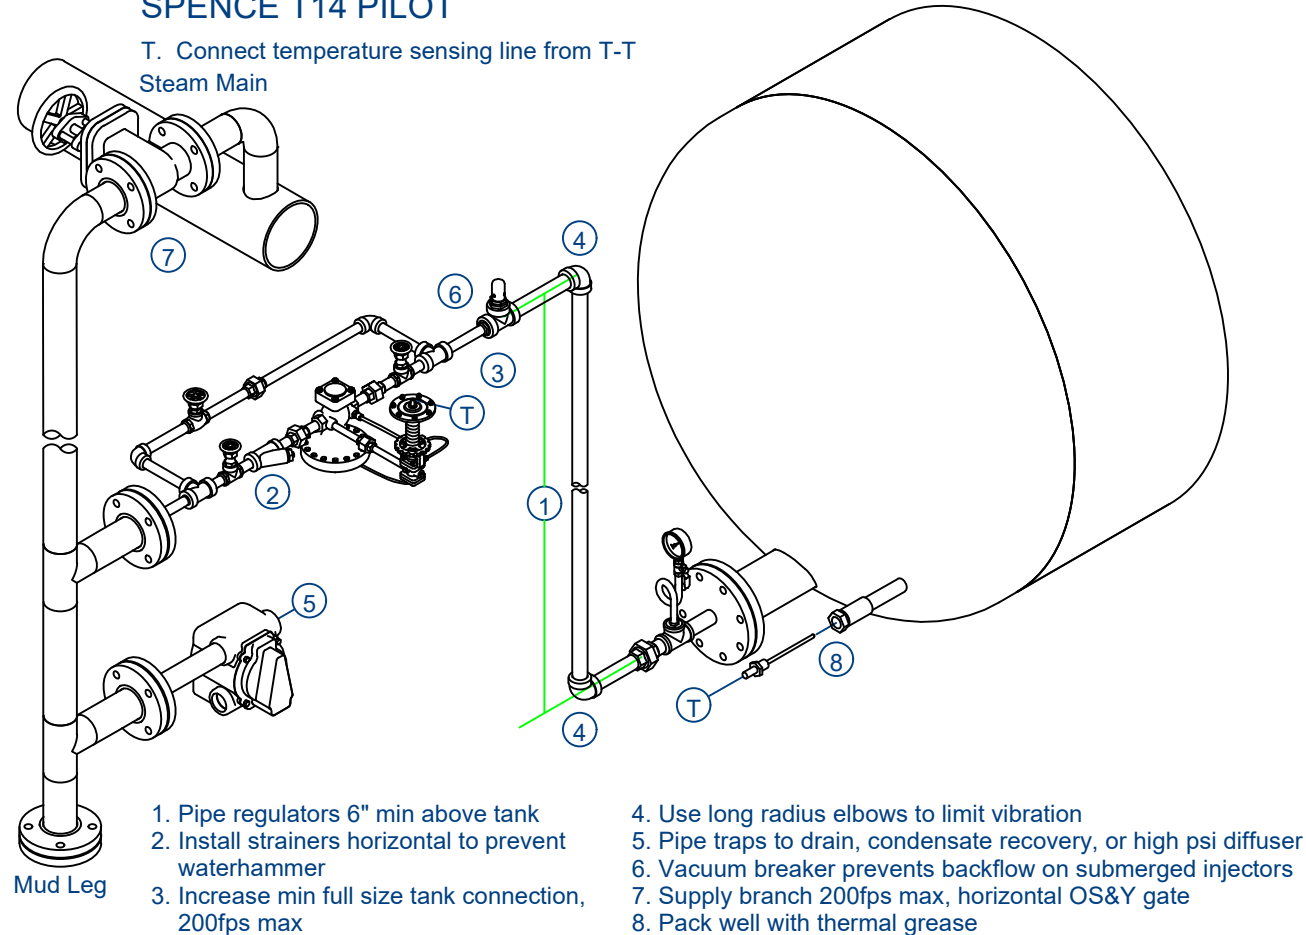

SHIPPENSBURG PUMP CO., INC.

P.O. Box 279 Shippensburg, PA 17257
(717) 532-7321 • www.shipcopumps.com

SHIPCO® is a registered trademark of Shippensburg Pump Co., Inc.

SPENCE™ Type E Regulator and Type T14 Temperature Pilot

SECTION	DRAWING NO.	REV.	DATE	COPYRIGHT © 2026
PIPE	REG-PIPE-ET14	1	9/4/2026	